

# Instructions

Eagle Quantum Premier®  
Remote Power Supply  
for Hazardous Locations  
Model EQ3900RPS



# Eagle Quantum Premier® Remote Power Supply for Hazardous Locations Model EQ3900RPS

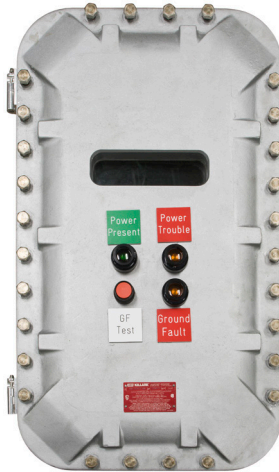


Figure 1—External View of EQ3900RPS

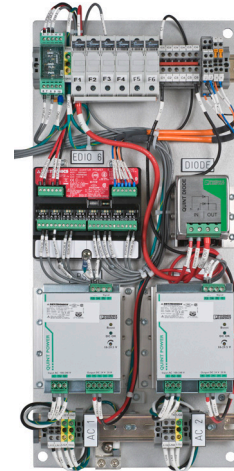


Figure 2—Internal View of EQ3900RPS

## DESCRIPTION

As part of providing a total systems solution to industrial clients around the world, Detector Electronics Corporation offers a certified power supply for mounting in hazardous locations.

The EQ3900RPS Remote Power Supply is an industrial power supply that accepts two independent AC inputs and produces 24 Vdc with up to 18 amperes output current. The EQ3900RPS remote power supply can be configured with various numbers of 24 Vdc power outputs, fuse monitoring, and status indicators. It is intended for use in hazardous locations, with certification for Class I, Division 1 and Class I, Division 2 per the National Electrical Code.

### NOTE

*The EQ3900RPS uses previously approved EQP2120-PS power supplies. Refer to the EQP System Manual (form 95-8533) for more information on EQP2120-PS power supply requirements.*

## IMPORTANT

*The two independent AC inputs must be reviewed and accepted by the local Authority Having Jurisdiction (AHJ) as fulfilling the requirements of a primary and secondary power supply according to NFPA 72.*

The EQ3900RPS has been approved by FM and CSA for use with the Det-Tronics Eagle Quantum Premier® System.

## FEATURES

- Hazardous area certified solution (Explosion-proof Class I, Division 1)
- Simple wire installation into terminal blocks
- Electronics and wiring tested at the factory

## ENCLOSURE

The EQ3900RPS uses a 12x24x12 explosion proof enclosure, the same as is used for the Det-Tronics EQ3900E. Depending upon the equipment selection, the front door may or may not have a window, indicators, and operators installed.

## SPECIFICATIONS

### INPUT—

120/220 VAC nominal, 50/60 Hz  
6 amperes maximum

### OUTPUT—

24 Vdc nominal - cannot be adjusted  
18 amperes maximum

### CERTIFICATION—

For complete approval details, refer to the appropriate Appendix:



Appendix A - FM

Appendix B - CSA

Refer to the Eagle Quantum Premier manual (form number 95-8533) for system certification details.

### WEIGHT (Approximate)—

250 pounds (114 kg)

### STORAGE AND OPERATING ENVIRONMENT—

0-95% RH non-condensing

Storage -20°C to 60°C

Operating -20°C to 50°C

## INSTALLATION

The enclosure must be securely bolted in place using the provided mounting hardware per the manufacturer's instructions.

### MOUNTING

Refer to the drawing in Figure 1 for mounting dimensions.

### ENCLOSURE ENTRY

The number and position of wiring entries must be specified when the enclosure is ordered. The enclosures can accept a certain number and size of entries as specified by the enclosure manufacture. Only suitably certified cable glands or stopping plugs can be used; see ratings. Consult with Det-Tronics Corporation on the exact number and sizes of entries that are available.

## WIRING INSTRUCTIONS

Electrical wiring schematics for the custom device configuration will be provided with the power supply. Wiring is made to the appropriate terminals located inside of the enclosure and is secured in place. Field wiring rated at least 10°C above maximum ambient must be used.


## ORDERING INFORMATION

Refer to the EQ3900RPS Model Matrix for details. Please note that the only operator that can be installed in the EQ3900RPS is the "Ground Fault Test" operator, which creates a ground fault in order to test the Ground Fault monitoring circuit.

## EQP EQ3900RPS Model Matrix

MODEL	DESCRIPTION	
EQ3900RPS	Remote LON Based Power Supply	
	TYPE	ENCLOSURE
	E	Explosion-Proof (Class I, Division 1)
	N	Non-Incendive (Class I, Division 2)
	TYPE	24 VDC POWER OUTPUTS (NOTES 1 & 3)
	1	1 24Vdc Power Output (18 Amp Fuses)
	2	2 24Vdc Power Outputs (9 Amp Fuses)
	3	3 24Vdc Power Outputs (6 Amp Fuses)
	TYPE	FUSE MONITORING (NOTES 2 & 3)
	0	0 Fuse Monitoring
	1	1 Fuse Monitoring (Power Output: #1)
	2	2 Fuse Monitoring (Power Outputs: #1 & #2)
	3	3 Fuse Monitoring (Power Outputs: #1, #2, & #3)
	TYPE	INDICATORS (MORE THAN ONE CAN BE CHOSEN) (NOTES 3 & 5)
	N	No Indicator or Operator
	A	Power Present Indicator
	B	Power Trouble Indicator
	C	Ground Fault Indicator
	D	Ground Fault Test Operator
	TYPE	WINDOW
	N	No Window
	W	Window

- NOTES: 1 Maximum total current draw = 18 amperes. All power outputs have same fuse rating.  
 2 Fuse monitoring by EQP only. No local indication.  
 3 Consult factory if other configurations are desired.  
 4 Consult factory for size and number of conduit entries.  
 5. No ingress rating if operators are included

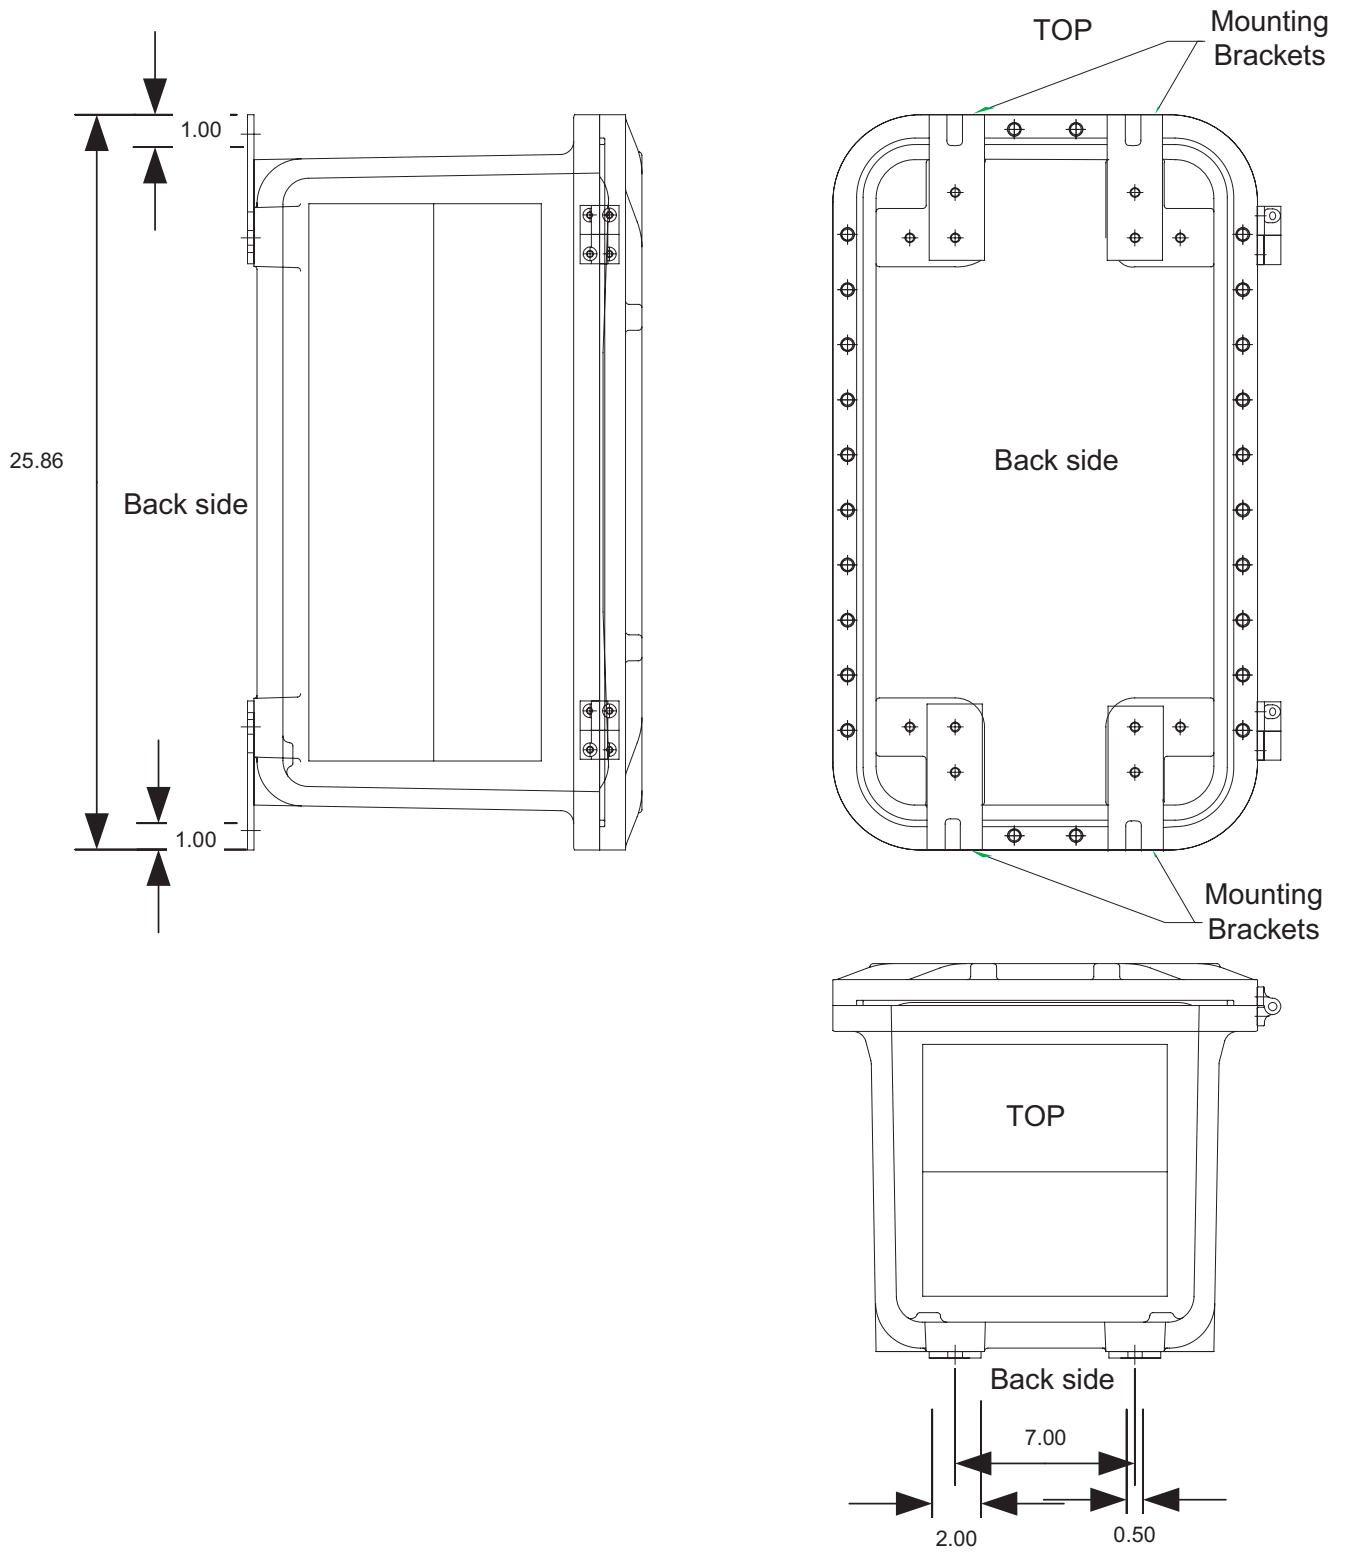

**Figure 1 — EQ3900RPS Explosion-proof Enclosure - Mounting Dimensions**

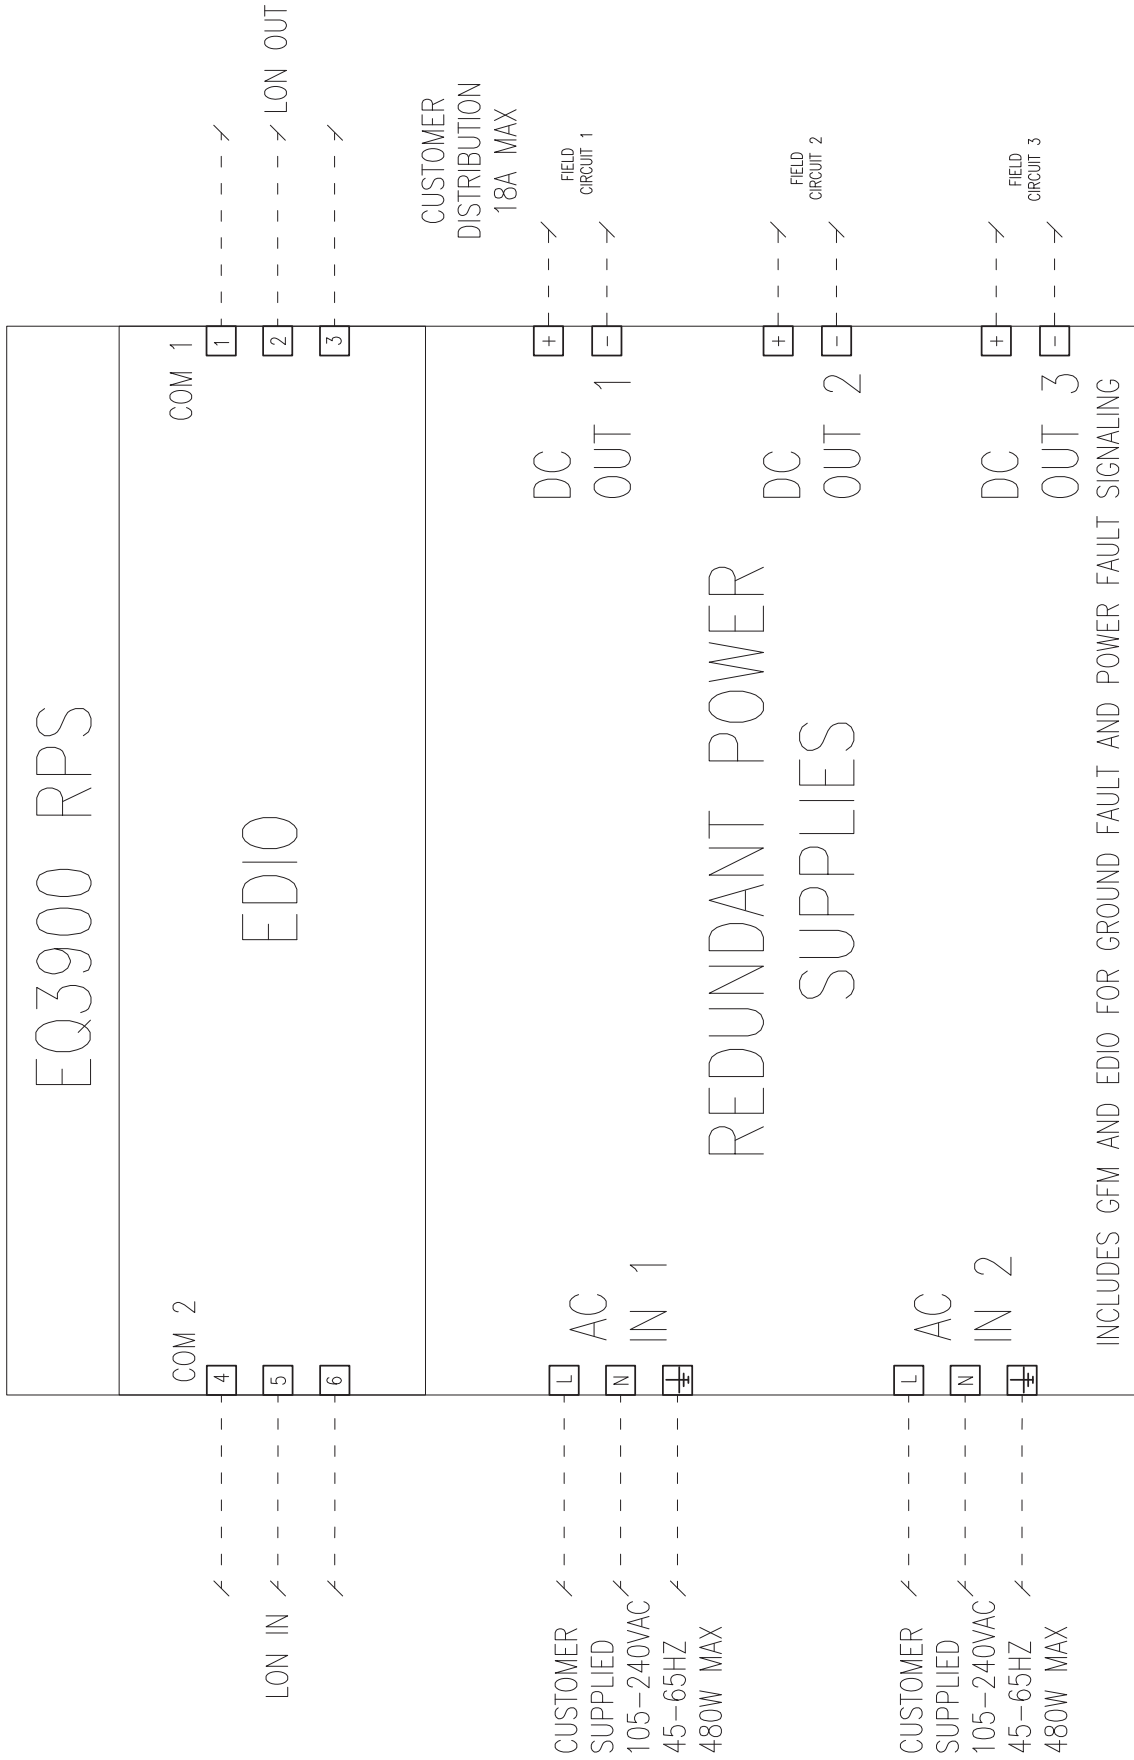


Figure 2 — Typical Wiring Diagram

## **APPENDIX A**

### **FM APPROVAL**

#### **EQ3900RPS**

Hazardous Location Rating:  
Class I, Div. 1, Groups C and D (T6)  
NEMA/Type 4 (Only when no operators are installed)

Ambient Temperature: -20°C to +50°C  
Input Voltage: 120-220 VAC, 50/60 Hz  
Input Current: 6 Amperes Maximum  
Output Voltage: 24 Vdc - cannot be adjusted  
Output Current: 18 Amperes Maximum  
Enclosure: Killark EXB-122412 with or without GLXR27 Window.

## **APPENDIX B**

### **CSA APPROVAL**

#### **EQ3900RPS**

Hazardous Location Rating:  
Class I, Div 1, Groups C and D (T5/T6)  
Class I, Div 2, Groups A, B, C, and D (T4)  
Class II, Div. 1, Groups E, F, and G (T4)  
Class III, Enclosure Type 4  
NEMA/Type 4 (Only when no operators are installed)

Ambient Temperature: -20°C to +50°C  
Input Voltage: 120-220 VAC, 50/60 Hz  
Input Current: 6 Amperes Maximum  
Output Voltage: 24 Vdc - cannot be adjusted  
Output Current: 18 Amperes Maximum  
Enclosure: Killark EXB-122412 with or without GLXR27 Window



95-8745



FlexSonic® Acoustic  
Leak Detector



X3301 Multispectrum  
IR Flame Detector



PointWatch Eclipse® IR  
Combustible Gas Detector



FlexVu® Universal Display  
with GT3000 Toxic Gas Detector



Eagle Quantum Premier®  
Safety System

Specifications subject to change without notice.

All trademarks are the property of their respective owners.  
© 2020 Detector Electronics Corporation. All rights reserved.

Det-Tronics manufacturing system is certified to ISO 9001—  
the world's most recognized quality management standard.



**Corporate Office**

6901 West 110<sup>th</sup> Street  
Minneapolis, MN 55438 USA  
[www.det-tronics.com](http://www.det-tronics.com)

Phone: +1 952.941.6665  
Toll-free: +1 800.765.3473  
Fax: 952.829.8750  
[det-tronics@carrier.com](mailto:det-tronics@carrier.com)